
#### Description



The SANICUBIC 1 is a lifting station designed to evacuate the waste from up to 2 WCs and multiple other waste water producing appliances Please comply with all the installation and maintenance specifications set out in these instructions, and especially the information marked with the following signs:



Failure to comply with this information could entail safety hazards for personnel

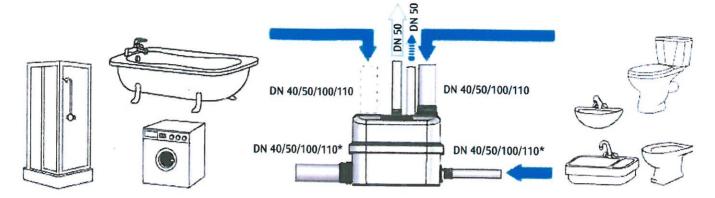

Information warning of the presence of an electrical hazard



2 m

WARNING - Failure to comply with this information could affect the normal operation of the equipment.



Instructions only for qualified professional specialists

#### SANICUBIC 1 OPERATING PRINCIPLE

SANICUBIC 1 contains 1 pump equipped with a high performance maceration system.


The SANICUBIC 1: tank is fitted with 2 dip tubes; one tube controls motor operation, and the other one controls the alarm system.

- Long pick up tube (normal operation); as soon as the waste water level in the tank reaches the triggering point in the long tube, the pumping system starts up.
- Short pick up tube (inflow overload operation); if the waste water level in the tank reaches the upper point, a contact is activated. This contact sets off a visual alarm, the LED alarm on the control panel switches to red.

The SANICUBIC 1 is fitted with an optional alarm unit (cabled, that monitors the equipment's operational status by producing visual signals.



#### 3. Dimensions and overall measurements

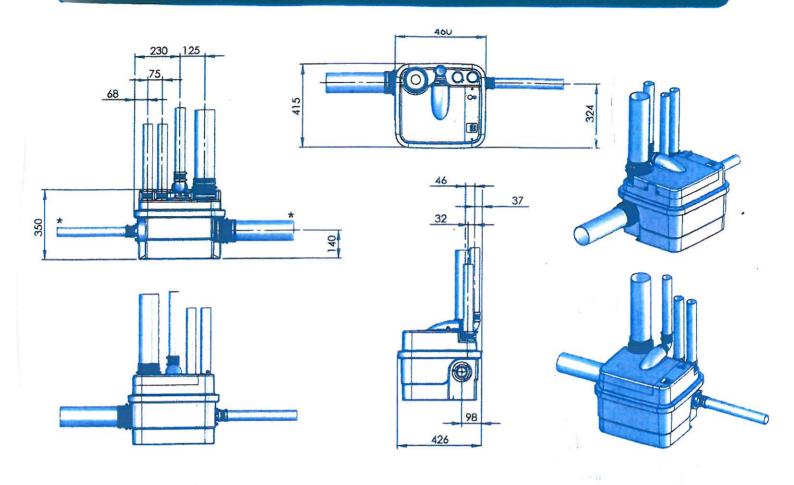

## 4. Technical Data


Туре	R350	Maximum current input	6 A
Maximum discharge head	11m	Electrical classification	1
Voltage	220-240V	Ave water temp for optimum performance	35°C
Frequency	50Hz	Maximum temperature (intermittent)	70°C*
Volume	321	Protection index	IP67
Maximum power input	1500w	Net weight (including accessories)	16 kg

<sup>\*</sup>Hot water drain cycles from dishwashers or washing machines


# 5. Field of Application

Waste from 2 WCs and other wastewater producing appliances. (The combined inputs must not exceed 80% of those shown in the graph in **Section 6**)

#### 6. Performance Curve

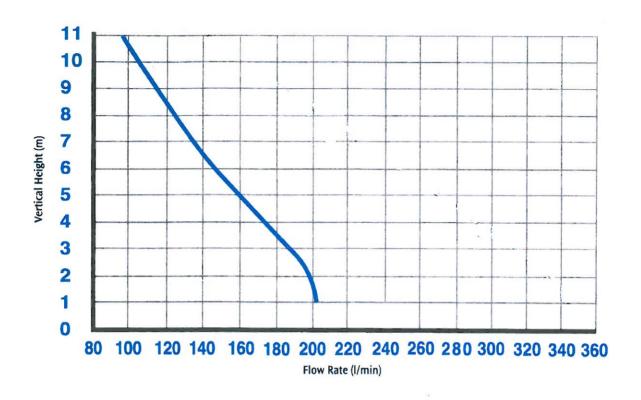

#### 7. Ratio of Height / Length for Discharge

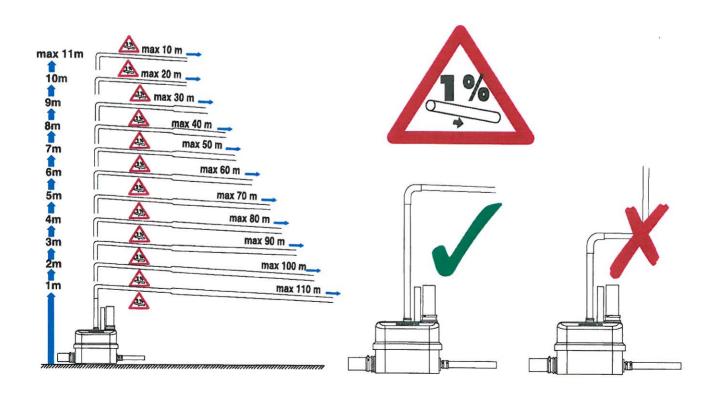

#### 8. Installation

The SANICUBIC 1 must be installed in compliance with standard EN12056. The equipment must be commissioned and maintained by a qualified professional specialist.

Please refer to installation standard EN 12056.

#### 8-1. Important Installation Specifications

- Attention: the space in which the SANICUBIC 1 is to be installed must be large enough to leave at least 600 mm of working room around and above the unit to facilitate such maintenance work as may be required. There must be sufficient lighting and it must be sufficiently well ventilated and protected from freezing.
- Isolation valves must be fitted on the 50mm discharge pipe work and on all inlet pipe work including WCs and other sources. This is
  required by the standard EN 12056 and to allow any possible maintenance work to be carried out without serious flooding.


Note: If isolation valves are not fitted service/maintainance may be impossible and any associated costs will not be covered by the Saniflo warranty. 4"/110mm and 2"/50mm isolation valves are available on the market but you may also purchase a suitable isolation valve kit direct from Saniflo Ltd. Please call 0208 842 0033'

3. The discharge pipe must be fitted so as to avoid all back flow from the drainage system (see the example drawings in Section 8-2). Back flow can be avoided by installing an anti-back flow riser reaching a high point above the maximum back flow level.

Comment: In the absence of local information to the contrary, the maximum back flow level corresponds to street level (roadway, pavements, etc.). Continue the discharge pipework after the anti-backflow riser using a larger diameter pipe.

- 4. If the Sanicubic is installed in a space such as a pit for example, we would recommend the fitting of a bilge pump in case of flooding.
- 5. The Sanicubic must be vented with an outlet at roof level. The vent should be taken from one of the two 40mm connections located either side of the 50mm discharge outlet. The Sanicubic will not be able to operate at all if this vent connection is not opened up! Do NOT fit air admittance valve on the top of the air vent pipe. The vent must be an open vent or the unit will not operate.
- 6. The lifting station must be fixed to the floor (see paragraph in Section 8-8).

#### 8-2. Installing the anti backflow loop

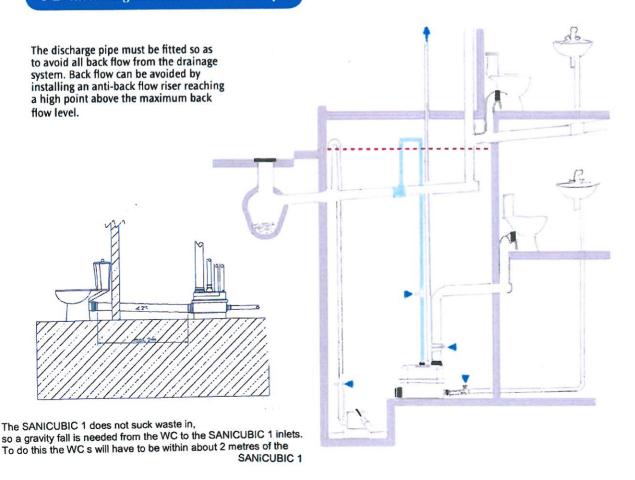


#### 8-3. Connecting the Discharge Pipe

Remove the end cover or covers from the back of the unit, see **Section 8-2** (1). As the pump is fitted with a macerator system, a **DN50 mm** discharge pipe be used.

The discharge bend is at the centre of the unit, at the back, see diagram to the right. Use the sleeve (D) to connect it to the riser pipe and fix it in place with the collars.

The pump in the SANICUBIC 1 unit is fitted with check valve. See paragraph in Section 8-1 regarding control valves and back flow.

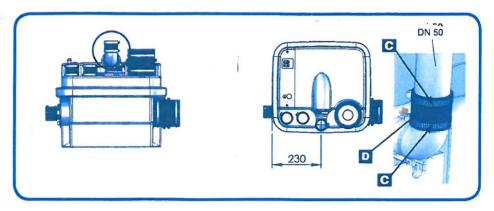

#### 8-4. Connecting Sanitary Equipment to the Lower Inlets




If you want to install a shower or a bath at the same level as the SANICUBIC 1 you must make sure that the upper parts of the plugholes on the sanitary equipment are at least 250 mm above the lower inlets. It is also very important that you fit an in-line non return valve between the shower tray and the Sanicubic inlet.

Sanicubic is not suitable for disposal of waste containing grease and fat. It is likely to cause blockages in the activation pressure tubes unless a full grease trap is installed. For kitchen waste please use Sanispeed or Sanicom.

#### 8-5. Connecting the Inlets DN 40/50

#### Lower inlets (dia.1) Upper inlets (dia.2)

- · Cut off the end of the DN 50 inlet with a saw.
- · Cut the sleeve (D) to suit the pipe diameter: DN 40 or DN 50 (dia.3).
- · Fix the sleeve on the inlet and on the pipe, using the collars.

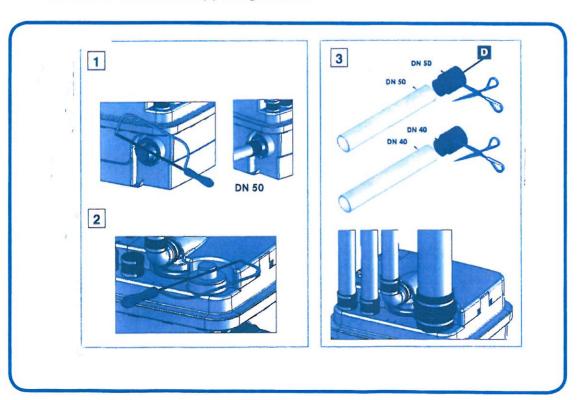


#### 8-6. Connecting the DN 100/110 Inlet

#### Lower inlets (dia 1)

- · Remove the plug from the side inlet.
- · Fix the sleeve (F) in place using the collar (J).
- Fully insert the DN 100/110 tube in the other end of the sleeve and fix it in place using the other collar (1).

#### Upper inlets (dia 2)

- · Cut off the upper end of the DN 100 inlet with a saw.
- Fix the sleeve (F) in place using the collar (I).
- Fully insert the DN 100/110 tube in the other end of the sleeve and fix it in place using the other collar (I).

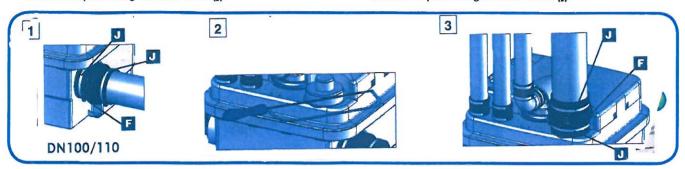


#### 8-7. Connecting the Vent

One of the upper DN50 inlets must be used for the vent. The vent pipe must be fitted up to roof level.

Cut off the end of the one of the DN50 inlets with a saw.

Then fix the sleeve (D) in place using the collar (C). Fully insert the DN40 tube in the other end of the sleeve and fix it in place using the other collar (C). WARNING; do not fit air admittance valve It must be an open vent or it will not work.

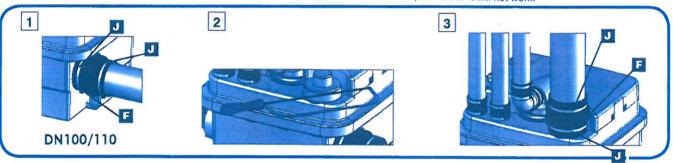

#### 8-8. Fixing the SANICUBIC\* Pro to the floor

The **SANICUBIC 1** unit is equipped with fittings to hold it on the floor and prevent it from turning or moving.


- 1 Place the unit on the desired spot.
- 2 Draw the outline of the unit.
- 3 Position the brackets and fix them to the floor as shown on the template diagram to the right.
- 4 Put the unit back in place.
- 5 Fix the unit in place with the screws.

# B

#### 8-9. Isolation valves

Service /maintenance is only possible if all inlets can be isolated.

4"/110mm and 2"/50mm isolation valves are available on the market but you may also purchase a suitable isolation valve kit direct from Saniflo Ltd. Please call 0208 842 0033.

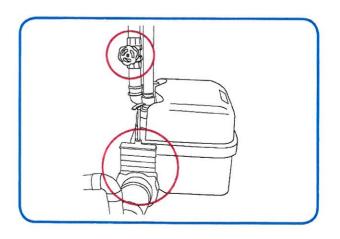

#### 8-10. Electrical Connections



The electrical installation should be carried out by a qualified person.



CANADA USA



**EUR** 



CH



GB

The electrical installation must comply with standards in force in the country concerned.

The power supply must be of the class 1 type. The unt must be connected via an eathed connection box. The electric power circuit must be protected by a high sensitivity 30 mA differential circuit breaker set at 20 A. The connection must be solely used to power the SANICUBIC 1. If the power lead on the unit is damaged, it must be repliced by the manufacturer or its after-sales service to avoid any danger.

W. A. \* \* \* \* \* 124 . . . 201

#### 9. Alarm Operation

#### SANICUBIC®1 Société Française d'Assainissement EN 12050-1

**R300** 220-240 V - 50 Hz 3000 W - ÷







**ALARM OPERATION** 

#### 1/ General alarm:

High level alarm:

If the water level inside the appliance is unusually high, the red alarm LED will light up.

#### Time alarm:

If the motor runs for over 1 minute, the red alarm LED will light up.


#### 2/ resetting the general alarm:

The control panel button can only switch off the red LED (it turns green) if the problem causing the alarm is resolved.

#### 3/ Mains alarm:

If the green LED on the control panel is flashing, it means that the mains electrical power has temporarily been cut off.

#### **UNIT ALARM**

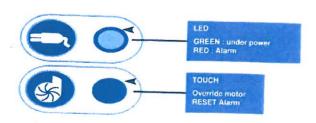

#### VENTING THE ELECTRICAL CONTROL PANEL

Connect the 8/11 clear PVC tubing supplied to the keyboard on the SANICUBIC1. The other end of this tubing must be located between 1 metre and 2 metres above the device to avoid getting water into the electrical control panel in the event of surcharge of the incoming waste.

Important: ensure that the tube is not pinched or kinked.

#### 10. Conformity with standards

SANICUBIC 1 complies with standard EN 12050-1 (lift station for household waste containing faeces) and with the European directives
covering construction products, electrical safety and electromagnetic compatibility

This unit must be installed and used in compliance with European installation standard EN12056 and with local requirements.

#### 11. Commissioning

- Once the plumbing and electrical connections have been made, check that the connections are watertight by letting water flow successively through each inlet used. Make sure that the unit is operating correctly by carrying out at least two start cycles with water to test the system.
- WARNING! When connected to the power supply, the green 'mains' LED will flash. Press the button on the control panel and the green LED will show continuously. Operation without water damages themaceration system.

#### 12. Use

- 1 The SANICUBIC 1 unit is designed to drain off 2 WCs & waste water. Any other use will invalidate the guarantee. Do not dispose of sanitary towels, condoms, hygiene articles, oils, solvents, acids, or any other potentially corrosive or explosive liquids etc, via the unit.
- 2 Warning! In the event of a power failure, stop draining any water from the equipment connected to the SANICUBIC 1 unit.
- 3 Do not install or use the unit in a zone where there is a risk of explosion.

#### 13. Maintenance


A visual check of the lift station must be made once a month to make sure it is operating correctly, and the installation must be inspected regularly (once a year) by a qualified person. Meanwhile, if any technical problems are experienced, please call our after sales service.

#### 14. Guarantee

The SANICUBIC 1 unit is guaranteed for two years (parts and labour) provided that it has been installed and used in compliance with the present instructions.

#### Saniflo Ltd, Howard House, The Runway, S Ruislip. Middx HA4 6SE

For technical advice or service please call 0208 842 0033 or service linkline 08457 650011 from a landline to connect to your nearest local service engineer.

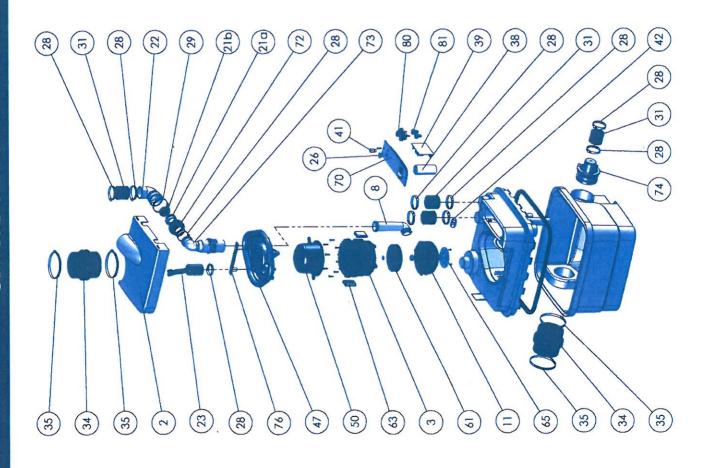

SOCIETE FRANÇAISE D'ASSAINISSEMENT 8, rue d'Aboukir 75002 Paris 16i. 01 44 82 39 00 Fax 01 44 82 39 01 E STATISTE

**Middx..** HA4 6 \$E Tel. 020 8842 0033 / 4040 Fax 020 8842 1671 UNITED KINGDOM Howard House, The Runway South Ruislip SANIFLO Ltd.

SANIRISH Lid IDA Industrial Estate Edenderry County Offaly Tel. + 353 46 9733 102 Fax + 353 46 97 33 093 IRELAND

SANIFLO AUSTRALIA Unit 7, 15 Howleys Road, Notting Hill P.O. Box 5122 Pinewood Victoria 3149 AUSTRALIA

Melbourne [el. +61 3 9543 3891 Fax +61 3 9543 6851 DEUTSCHLAND

**SFA SANIBROY GMbH**Woldstr. 23 **Geb. B5 63128 Dielzenbach**Tel. (060 74) 30928-0
Fax (060 74) 30928-90

Na Koš ince 180 00 PRAHA 8 - Libeň Tel: +420 266 712 855 Fax: +420 266 712 856 SFA-SANIBROY, spol. s r.o SFA SANIFLO S.R.L. ROMANIA

Strada Leonard Nicolae, nr. 2A Timisoara 300454 Tel. +40 256 245 092 Fax +40 256 245 029

宁波舒福安卫济设备有限公司 升利保

SERVICE HELPLINES

> reland France

tala

ITALIA

Via del Benessere, 9 27010 Siziano (PV) Tel. 03 82 61 81 Fox 03 82 61 8200 SFA ITALIA spa

SANIFLO AB BOX 797 S-191 27 Sollentuna

fel. + 08-404 15 30 Fax + 08-404 15 39

08130 Sta. Perpètua de Mogoda - Barcelona C/ Vinyalets, 1 P.I. Can Vinyalets GRUPO SFA ESPAÑA

ul. Kolejowa 33 **05-092 Lamianki/Maszawa** Tel. (+4822) 732 00 32 Fax (+4822) 751 35 16

SFA POLAND ul. Kolejowa 33

POLSKA

Av 5 de Outubro, 10 -1° Tel. +34 93 544 60 76 Fox +34 93 462 18 96 PORTUGAL SFA Lda

**1050-056 Lisboa** Tel. +351 21 350 70 00 Fox +351 21 957 70 00

ČESKÁ REPUBLIKA

Ten. (495) 258 29 51 факс (495) 258 29 51

SFA POCCUR 101000 Mockea Колпачный пер. 9а, ком. 103

РОССИЯ

SUISSE SCHWEIZ SFA SANIBROY AB SVIZZERA Steffenstrasse 6 SWITZERLAND

CH-8954 Geroldswil Tel. +41 44 748 17 44 Fox +41 44 748 17 43

Voltaweg 4 **6101 XK Echt** Tel. +31 475 487100 Fax +31 475 486515 SFA BENELUX B.V. BENELUX

宁波市鄞州区雅源南路480号(31515: T. 0574 – 8817 1777 F. 0574 – 8728 1907

08457 650011 (Call from a land line) 1850 23 24 25 (LOW CALL) +61 3 9543 3891 0800 82 27 82 0 0382 6181 Nº Azur 0 810 05 90 02 España +34 93 544 60 76
Portugal +351 21 350 70 00
Suisse Schweiz Svizzera +41 44 748 17 44
Benelux +31 475 487100 (495) 258 29 51 +420 266 712 855 +4822) 732 00 33 +40 256 245 092 08-744 15 18 Česká Republika United Kingdom Deutschland Australia România Sverige Россия

Service information: www.sfa.biz

+0574 - 8817 1777

<u>=</u>

+0574 - 8728 1907